



NOTES:

- ① ALL CURB RAMP SHALL BE POURED SEPARATELY FROM SIDEWALK AND SHALL CONTRAST VISUALLY WITH ADJACENT SIDEWALK SURFACES, IN ACCORDANCE WITH CITY STANDARD SIDEWALKS AS DEFINED IN SECTION 204 OF DPW STANDARD SPECIFICATIONS AND CURB RAMP STANDARD PLANS FILE NO 55,017 TO 55,018.
- ② CURB RAMP AND SIDEWALK SLAB-ON-GRADE ACCORDING TO SFDPW STANDARD SPECIFICATION SECTION 204 WITH #3 STEEL REINFORCED BARS AT MID-DEPTH OF THE CONCRETE SIDEWALK SLAB.
- ③ MINIMUM 3-FOOT REINFORCED BAR LENGTH WITH 3-INCH O.C. SPACING. AT LOCATIONS WHERE 3-FOOT REINFORCEMENT BAR LENGTH IS RESTRICTED, 2-FOOT REINFORCEMENT BAR LENGTH IS ACCEPTABLE WITH THE APPROVAL OF THE ENGINEER.
- ④ A 2-INCH MINIMUM DISTANCE IS REQUIRED FROM THE EDGES OF THE REINFORCEMENT TO A CONSTRUCTION JOINT.
- ⑤ INSTALL REINFORCEMENT ON A DIAGONAL TO ALL RE-ENTRANT CORNERS (PROPERTY CORNERS, CURB RAMPS, PULL BOXES, TREE WELLS, ETC.).
- ⑥ SCORE JOINTS SHALL HAVE A 1/4-INCH DEPTH AND BE IN ACCORDANCE WITH CITY STANDARD SIDEWALKS AS DEFINED IN SECTION 204 OF DPW STANDARD SPECIFICATIONS.
- ⑦ CONTRACTION JOINTS SHALL BE SPACED A MAXIMUM OF 15 FEET APART AND SHALL ENCLOSE AN AREA NO MORE THAN 250 SQUARE FEET.
- ⑧ FOR SAW CUT CONTRACTION JOINTS, CUT SLAB IMMEDIATELY AFTER INITIAL CONCRETE SET AND BEFORE FINAL CURING.

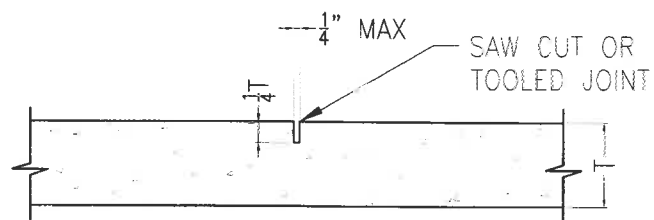

CONTRACTION JOINT

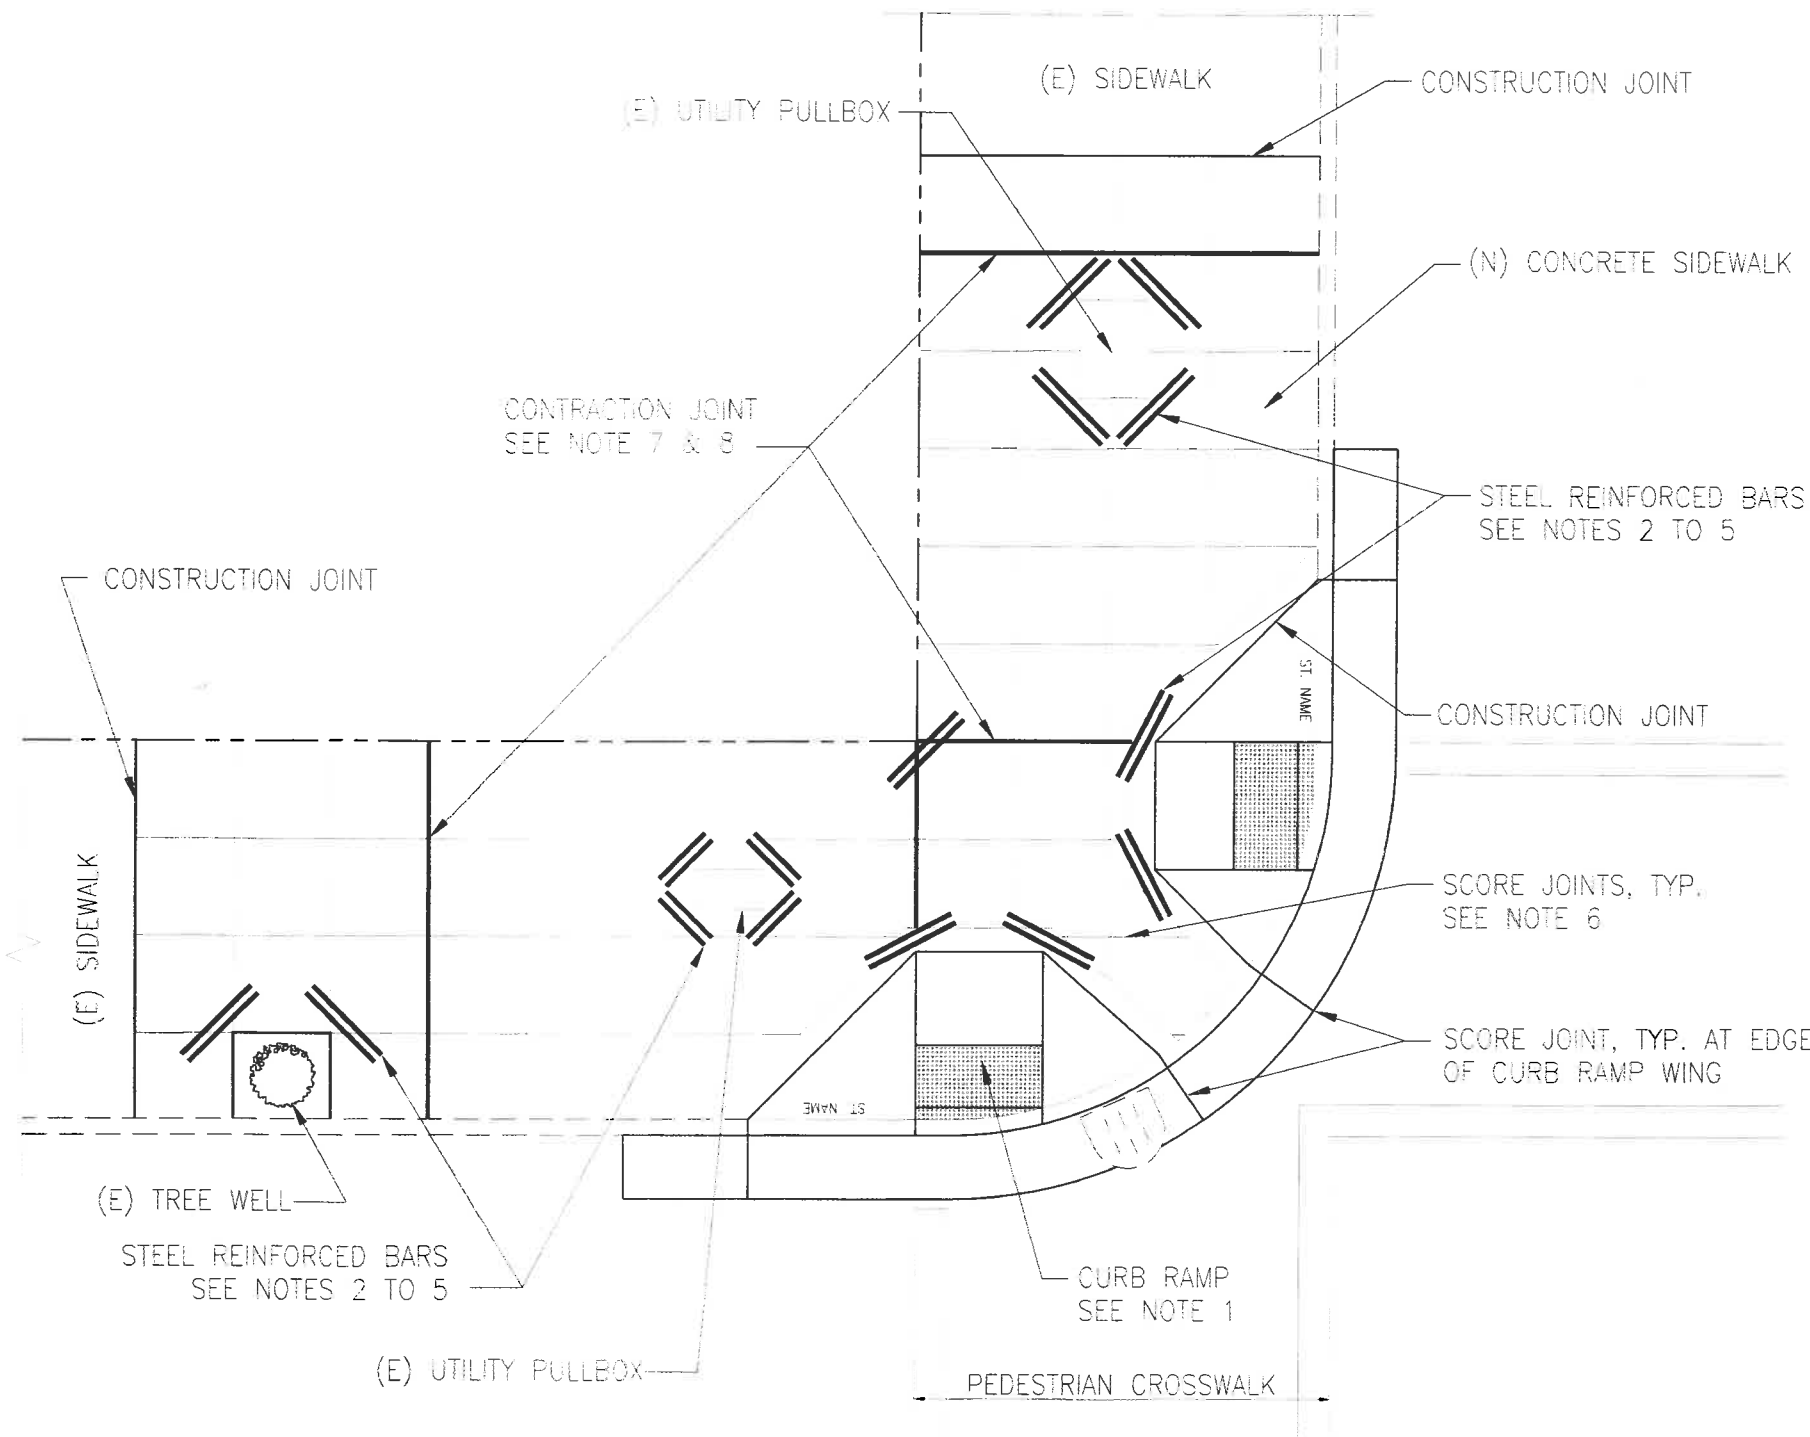

**REINFORCED SIDEWALK PLAN
TYPICAL LAYOUT
(NOT TO SCALE)**

This Standard Plan was developed for use on public works projects in the City and County of San Francisco, and shall not be used without consulting a Registered Professional Engineer. The Department of Public Works reserves the right to make revisions to this Standard Plan at any time.

NO.	DATE	DESCRIPTION	BY	APP.
1	3/4/14	REVISION TO NOTES AND DRAWING	YL	EK

TABLE OF REVISIONS
CHECK WITH TRACING TO SEE IF YOU HAVE LATEST REVISION

REFERENCE INFORMATION & FILE NO. OF SURVEYS



INFRASTRUCTURE DIVISION
DEPARTMENT OF PUBLIC WORKS
CITY AND COUNTY OF SAN FRANCISCO

REVIEWED	DATE	APPROVED	DATE
JH	09/2013	<i>Paul L. Conner</i>	3/4/2014
JH	09/2013	<i>Margaret Partridge</i>	2/6/2014
EK	09/2013	<i>Paul L. Conner</i>	2/3/14

STANDARD PLAN	DRAWING NO.
STREETS AND HIGHWAYS	NONE
STEEL REINFORCED BARS FOR SIDEWALK CONSTRUCTION	96,608
	1